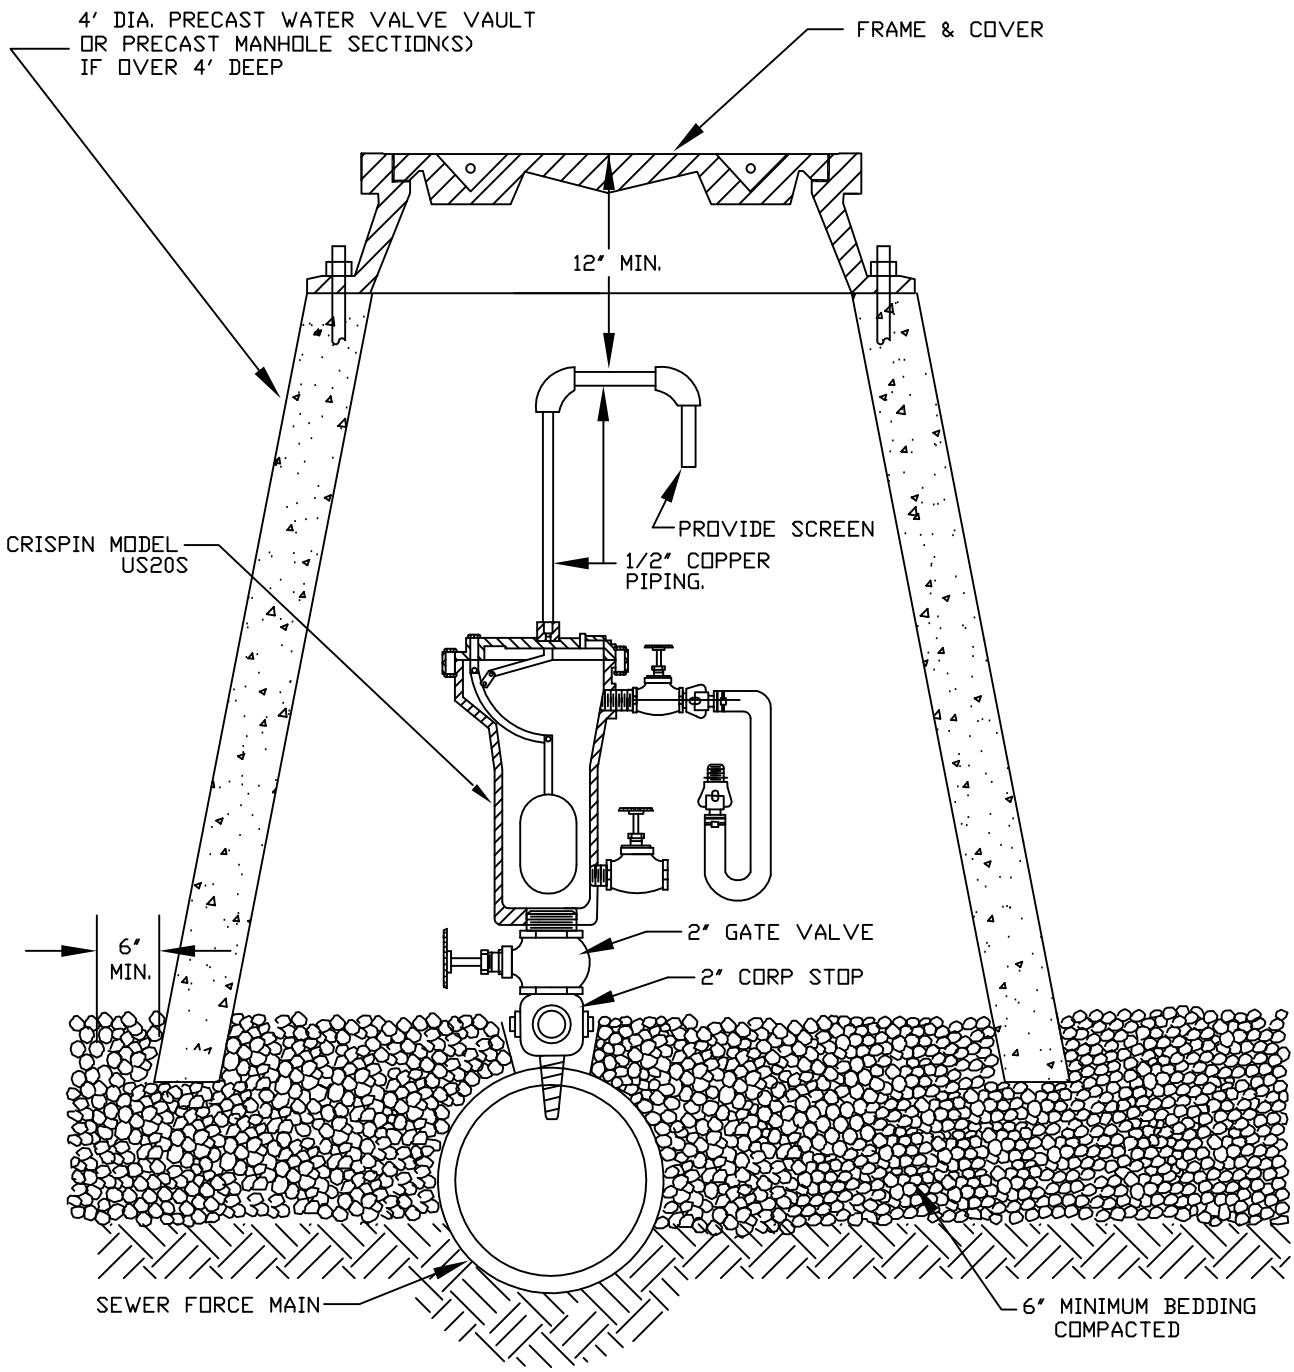

SADDLES MUST BE USED WITH ALL PLASTIC & CLASS 51 DUCTILE IRON PIPE 4" AND LARGER IN DIAMETER. TEES WITH THE BRANCH LEG OF 2" SHALL BE USED FOR ALL FORCE MAINS LESS THAN 4" IN DIAMETER. A 2" DIAMETER PORT SHALL BE PROVIDED FROM THE FORCE MAIN TO AIR/VACUUM VALVE.

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	9/01/07		

AUTOMATIC AIR/VACUUM RELEASE ASSEMBLY FOR USE ON SEWER FORCE MAIN

DRAWING S-23